

Nebraska Wastewater Surveillance Report

Facility Report for Hastings WWTP

Report for Week Ending: 6/8/24 (Week 23)

SARS-CoV-2 virus concentration in wastewater

Sample collection date: 6/4/2024


Result: **Not Detected**

Raw Concentration: 0 copies/L

Normalized concentration: **0.0M** copies/person

Normalized concentration is the raw concentration adjusted for sewage flow rate and population, in million virus copies per person.


SARS-CoV-2 normalized wastewater concentration weekly average

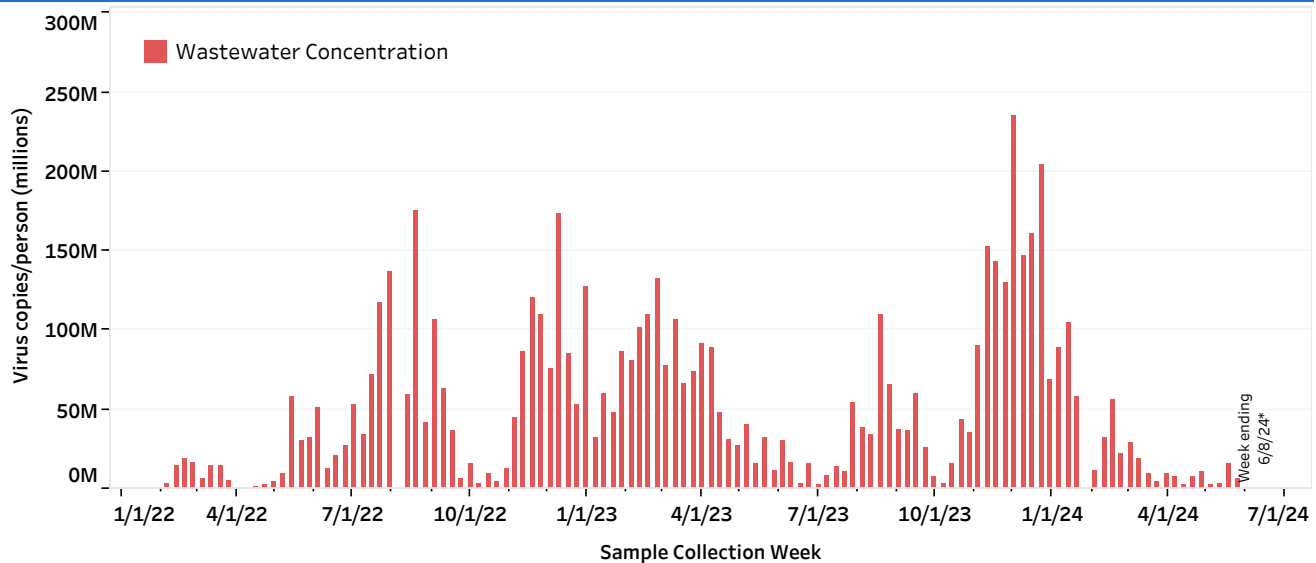

SARS-CoV-2 wastewater concentrations by collection date: Last 8 samples

	5/9/24	5/14/24	5/16/24	5/21/24	5/23/24	5/28/24	5/30/24	6/4/24
Raw Concentration (copies/L)	11,047	11,766	40,484	21,781	0	0	0	0
Normalized Concentration (copies/person)	6.4M	6.8M	23.3M	12.7M	0.0M	0.0M	0.0M	0.0M

Comparison of normalized virus concentrations to all other Nebraska sites in last 1 month

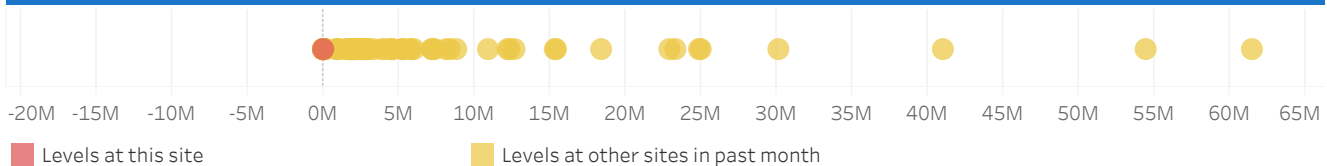

All data presented are preliminary and subject to change. WWTP=wastewater treatment plant; M=million.

Weekly average of Wastewater SARS-CoV-2 levels are shown as red bars. Levels shown here are normalized to adjust for flow rate and population.

*Wastewater data for the most recent week is marked as preliminary. Data may be revised when wastewater samples are received for previous weeks.

Data Source: Nebraska Wastewater Surveillance System (NeWSS). Project in collaboration between Nebraska DHHS, UNL, Nebraska Public Health Lab (NPHL), and local public health departments.

For more information: <https://www.cdc.gov/nwss/wastewater-surveillance.html>